


► BrunataNet RS485 Data Gathering System - Installation

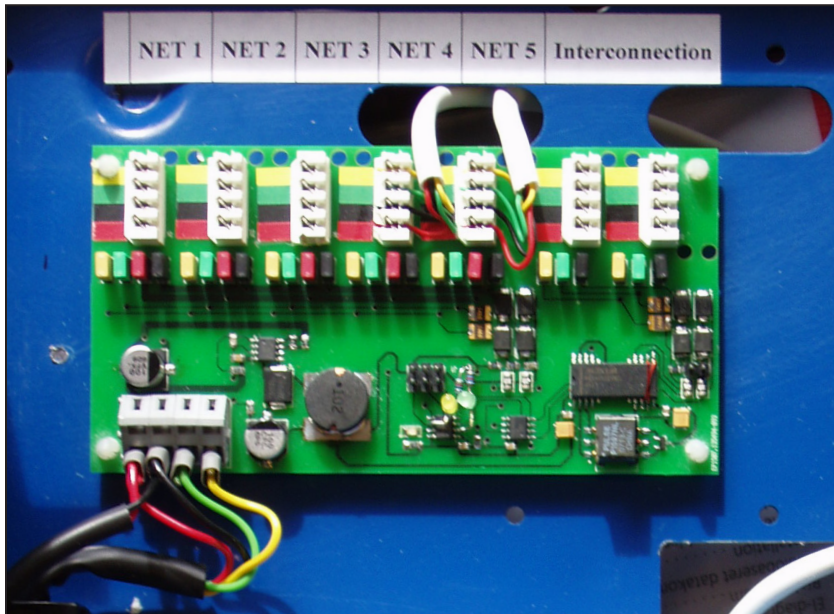

230 V connection via keylock switch

Data cables

- "Brunata PTH 2x2x0.6" (= 0.25 mm²) standard cable
- The above is a Repeater Box. The installation of both boxes is identical
- Connection terminals are colour indicated
- Cable assembly by means of cable clamp and ties
- Several cables may be connected to the same terminal

230 V connection

- Input power approx. 80 VA
- The boxes have no power switch
- 1.5 m AC cable with Danish 3-pole AC earthed connector
- Connection to 3-pole switched outlet or via keylock switch
- No replacement of fuse in boxes

Conforms to EN601010-1

- Class I
- Installation category II
- Pollution level 2

Brunata is a 100 % Danish owned company. We have more than 85 years of experience within developing and producing heat cost allocators and heating accounts. Brunata als has implemented a quality system in accordance with EN ISO 9001. Please contact us for further information on our products.